

Transmission Line Permit and Licence 21732-D02-2016

Appendix 1 to Decision 21732-D01-2016	July 6, 2016
ENMAX Power Corporation Alter Transmission Line 138-7.82L	Proceeding 21732 Application 21732-A001

ENMAX Power Corporation (ENMAX), pursuant to Permit and Licence U2004-153,¹ is the operator of the 138-kilovolt (kV) Transmission Line 138-7.82L from ENMAX No. 7 Substation to AltaLink Management Ltd. Sarcee 42S Substation in the city of Calgary.

ENMAX, by Application 21732-A001 registered on June 17, 2016, applied to the Alberta Utilities Commission for approval to alter and operate the transmission line by realigning a portion of the existing transmission line, located in Section 3, Township 24, Range 2, west of the Fifth Meridian, near an interchange at 69th Street and Glenmore Trail (Highway 8) in southwest Calgary.

The Commission, pursuant to sections 14, 15 and 19 of the *Hydro and Electric Energy Act*, approved the application in Decision 21732-D01-2016² and granted to ENMAX a permit to alter and a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application and previous applications.
2. Specifications of the transmission line shall include the following:
 - a) The transmission line shall be designed, built for and operated at a nominal voltage of 138 kV.
 - b) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
 - c) Other aspects of the alteration as more particularly described in the application and other previous approvals pertaining to the transmission line.

¹ Permit and Licence U2004-153, Application 1344485, May 31, 2004.

² Decision 21732-D01-2016: ENMAX Power Corporation– Southwest Calgary Ring Road Project, Realignment of a portion of Transmission Line 138-7.82L , Proceeding 21732, Application 21732-A001, July 6, 2016.

3. ENMAX shall file with the Commission within 30 days of completing the transmission line alteration, the energization certificate(s) for the transmission line issued by ENMAX, to confirm that the transmission line alteration has been completed and the transmission line is being operated in accordance with the provisions of this permit and licence.
4. Unless otherwise authorized by the Commission, the transmission line alteration shall be completed by January 31, 2017.

Permit and Licence U2004-153 is rescinded.


The Commission may cancel or suspend this permit and licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this permit and licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.

Alberta Utilities Commission

(original signed by)

Wade Vienneau
Executive Director, Facilities Division
On behalf of the Alberta Utilities Commission

R.2W.5M.

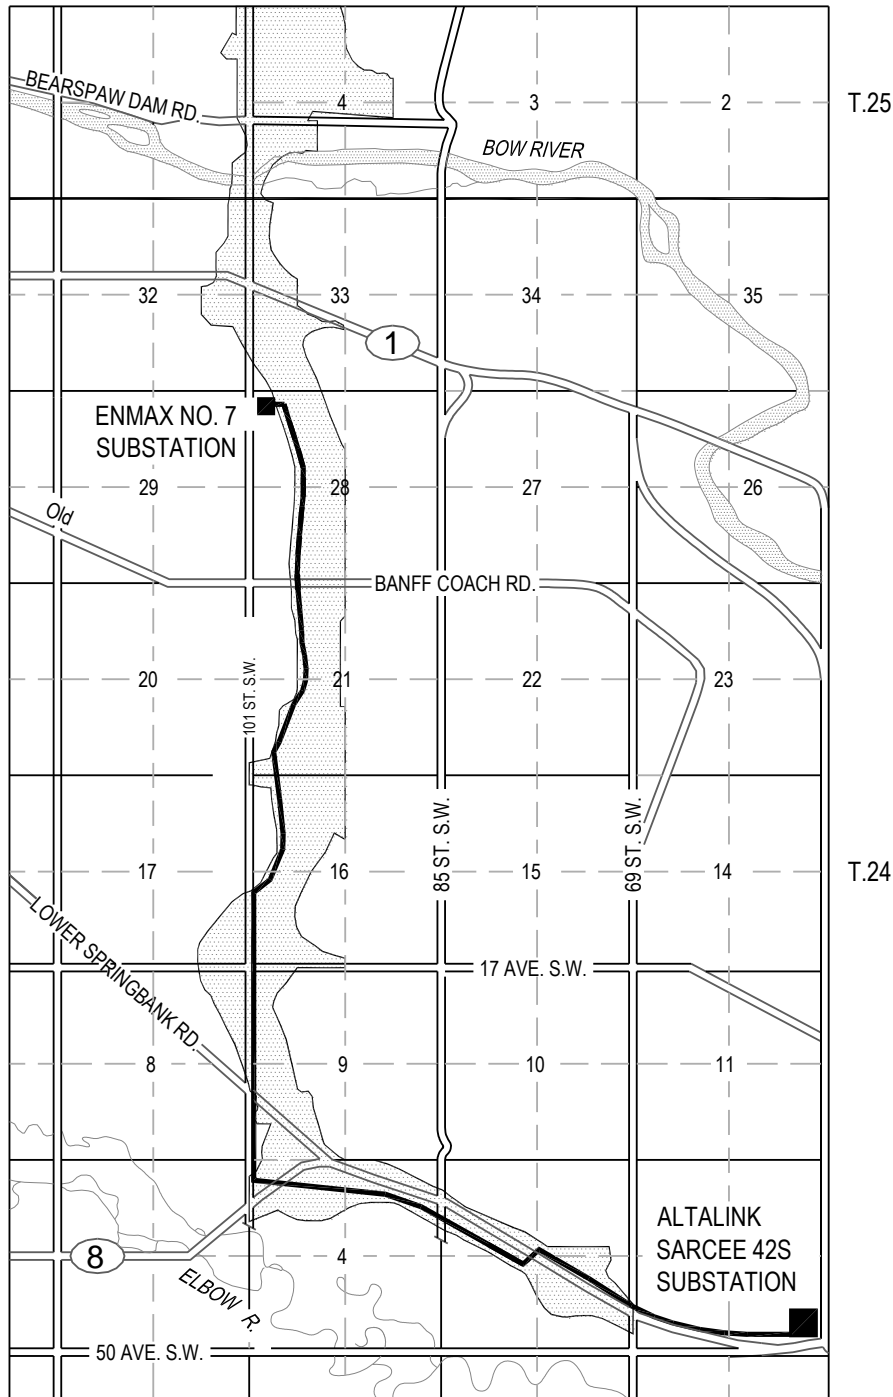

CITY OF CALGARY

APPENDIX A PERMIT AND LICENCE 21732-D02-2016

PREVIOUS PERMIT AND LICENCE U2004-153



LEGEND

-  ENMAX POWER CORPORATION 138-kV TRANSMISSION LINE 138-7.82